



Induction Motor Broken Rotor Bar Fault Detection Using Discrete Wavelet Transform

Ramin Salehi Arashloo
ramin.salehi@ieee.org

Alireza Jalilian
jalilian@iust.ac.ir

Dept. of Elec. Eng., Centre of Excellence for Power Systems Automation and Operation,
Iran University of Science & Technology,
Tehran, Iran

Keywords : induction motor, fault detection, Broken rotor bars, discrete wavelet transform (DWT), Root Mean Square (RMS).

Abstract :

Motor Current Signature Analysis has been successfully used in induction machines for broken rotor bars fault diagnosis. The method however does not always achieve good results when the load torque is not constant. For proper results temporal analysis on determined harmonics is needed. In this paper, a novel diagnostic algorithm based on a **discrete wavelet transformation** and RMS calculation is developed. The method is also examined on laboratory **experimental data** where rotor broken bar faults are detected successfully.

1- Introduction

As the backbone of modern industries, induction motors are the most commonly utilized electromechanical devices. These machines often provide the core capabilities for industrial advantages and the maintenance of them is easy, profitable and essential to

most industries .A lack of coherence in maintenance strategy may result in the loss of important items of a plant and may be a huge capitalized losses burden. In other words fault diagnostics of induction motors are very important to ensure timely maintenance, increased operation reliability, safe operation, and preventive rescue especially in large scale industries.

Different faults of induction motors are generally classified as either electrical or mechanical faults. Different types of faults include stator winding faults, rotor bar breakage, misalignment, static and/or dynamic air-gap irregularities and bearing gearbox failures. The most common fault types of these rotating devices have always been related to the machine shaft or rotor [1], [2]. It is estimated that about 38% of the induction motor failures are caused by stator winding faults, 40% by bearing failures, 10% by rotor faults, and 12% by miscellaneous faults. Rotor faults can result in excess heat,

decreased efficiency, reduced insulation life, and iron core damage. Therefore, early detection of impending rotor faults and appropriate maintenance can avoid more severe motor failures [3].

Fault detection systems of induction motors include at least two essential parts: feature extraction part and classification part. Feature extraction part extracts related features to specific fault modes. These features are usually obtained by processing the frequency spectrum of stator current using fast Fourier transform (FFT). There are some more possible alternatives such as short-time Fourier transform (STFT) and wavelet transform. The classification part goal is to classify different faulty modes from normal mode. For example, Expert systems, artificial intelligence (AI) and artificial neural network are often used [1].

In recent years, there is importance progress in the field of the fault analysis and maintenance of induction machines, with the extension of computer techniques, control techniques, and advance intelligence algorithms. Many methods of fault detection are proposed, such as the knowledge based method, the analytical model method and the signal processing method. The knowledge based method uses the interrelated information of objects diagnosed and the exact mathematics model of the system is not needed in knowledge based method. The precise mathematics model of object diagnosed is needed in the analytical model, including the state estimation, the parameter estimation, the equivalence space, etc. In the analytical model method the rigor diagnosis condition is required and this method has lots of limitation. The signal model is directly used in the signal processing method for the analysis of linear or non-linear systems, avoiding the difficulty of extracting mathematics models of objects. Signal processing method makes the spectral frequency analysis of the electric machines stator current [4], [7], [8].

The waveforms associated with electromagnetic transients are usually non-

periodic signals which contain both high-frequency oscillations and localized impulses superimposed on the main frequency and its harmonics. Traditional discrete Fourier transform (DFT) is not suitable for this kind of waveforms because a periodic signal is assumed in DFT calculations and power system disturbances are subject to transient and non-periodic components. The entire frequency spectrum can be affected if a signal is altered in a localized time instant [9].

The multiple-signal-classification method with an algorithm to zoom on a specific frequency range is proposed to overcome this drawback and for extraction of the meaningful frequencies from the signal. However, this method has only been implemented on stationary signals. Wavelet analysis is a new branch of mathematics since the late of 1980s. Wavelet transform technique provides a powerful tool for the field of fault detection. Wavelet transformation is both time-frequency analysis, and time scale analysis, with the multiresolution characteristic. It can detect partial feature of the signal in both time and frequency domain [4]-[8]. Induction motor is modelled and rotor broken bars fault is detected experimentally using park transform [5]. In [6] variance of wavelet coefficients energy in different areas is used to detect broken rotor bars.

The objective of this paper is to present a wavelet-based method for broken rotor bar fault detection in induction machines combined with RMS computation. The remainder of this paper is organized as follows:

Section II describes the most common faults in induction motors (IM) and their diagnosis using classical MCSA. A brief review of wavelet transform and proposed detection method is presented in section III, in section IV experimental result obtained by FFT calculation and wavelet transform are presented and compared and finally the summary and conclusions drawn from this study are presented in Section V.

2- SPECTRUM ANALYSIS OF STATOR CURRENT

The rotating magnetic field induces rotor voltages and currents at slip frequency and an effective three phase magnetic field is produced by these induced currents at slip frequency with regard to the rotor.

Two different cases can be appeared.

- 1) Symmetrical cage winding → only forward-rotating field
- 2) Asymmetric rotor → a backward-rotating field with respect to the rotor will result at slip frequency.

A voltage will be induced in the stator three phases by this backward-rotating field at the corresponding frequency and a related current which alters the stator-current frequency spectra also appears. Different faults will result in different rotating fields in squirrel cage induction machines such as broken rotor bars, air-gap eccentricity, stator-windings, short circuits and bearing damage.

The current frequencies associated with the rotating fields are expressed by (1), (2), (3), and (4).

- 1) Air-gap-eccentricity associated frequencies.

$$f_{ecc} = f_s \left[1 + m \left(\frac{1-s}{p} \right) \right] \quad (1)$$

where $m = 1, 2, 3 \dots$ is a positive integer number, s is the per-unit slip, p is the number of pole pairs and f_s is the electrical supply frequency associated frequencies.

- 2) Broken rotor bars.

$$f_{bdb} = f_s \left[l \left(\frac{1-s}{p} \right) \pm s \right] \quad (2)$$

where $\frac{l}{p} = 1, 5, 7, 11, 13 \dots$ are the characteristic values of the induction machine.

- 3) Bearing damage associated frequencies.

$$f_{bng} = |f_s \pm f_{i,o}|$$

$$f_{i,o} = \frac{n_b}{2} f_r \left[1 \pm \frac{b_d}{p_d} \cos \beta \right] \quad (3)$$

where n_b is the number of bearing balls, $f_{i,o}$ are the characteristic vibration frequencies, b_d is the ball diameter, p_d is the bearing pitch diameter, f_r is the mechanical rotor speed in hertz and β is the contact angle of the balls on the races.

- 4) Shorted turns associated frequencies.

$$f_{sth} = f_s \left[1 + m Z_2 \left(\frac{1-S}{P} \right) \right] \quad \text{d.1) medium frequencies}$$

$$f_{stl} = f_s \left[\frac{m}{p} (1-s) \pm k \right] \quad \text{d.2) medium frequencies (4)}$$

where z_2 is the number of rotor bars or rotor slots, and $k = 0, 1, 3, 5 \dots$ [10].

3- WAVELET TRANSFORM AND PROPOSED METHOD

The wavelet transform [WT] is a powerful tool in the field of power systems signal processing [9]. It has the advantage of flexibility in describing nonstationary signals which is an important advantage for variable load applications and power quality problems. Similarly, wavelet transform is the breaking up of a signal into shifted and scaled versions of the source (or mother) wavelet. There are many different wavelets.

The wavelet transform is divided into two main categories, continuous wavelet transform or discrete wavelet transform [3]. In wavelet transformation, the analysing wavelet functions will adjust their time-widths to their frequencies in such a way that lower frequency wavelets will be very broad and higher frequency ones will be narrower. Therefore, transient components of the signal in the upper frequency witch is isolated in a shorter part of power frequency cycle can be detected. The ability of WT to concentrate on long time intervals for low frequency components and short time intervals for high-frequency components leads to better evaluation of the signals with localized transients [9].

A. Continuous Wavelet Transform

Wavelet transform has the ability of performing through a multi-resolution analysis (MRA), several overlapped projections of a signal. For a signal $f(t)$, the generating function of the MRA can be expressed as

$$\varphi_k^j = 2^{-j/2} \varphi(2^{-j}t - k) \quad (5)$$

where, φ is the so-called mother wavelet; k is the time shift factor, and j indicates the decomposition level. The wavelet coefficients obtained by applying an orthogonal wavelet can be expressed as

$$d_k^j = \int_{-\infty}^{\infty} f(t) \psi_k^j(t) dt \quad (6)$$

where, ψ_k^j is the wavelet analyzing function. For instance, Shannon, Morlet, Debauche, Haar, etc, could be used. During the transformation process, the mother wavelet is shifted and scaled contiguously and the correlation of the examined signal and the mother wavelet produces the wavelet coefficients.

B. Discrete Wavelet Transform

In discrete wavelet transform, the mother wavelet is scaled in the power of 2. Therefore, it is a good choice for implementation in digital computers. Assume S is a discrete-time signal to be decomposed using the discrete wavelet analysis into its approximate and detailed versions. In the first decomposition level, the coefficients are cA_1 and cD_1 ; where, cD_1 is the detailed representation of S , and cA_1 is the approximate version of S . cA_1 and cD_1 are expressed as

$$cA_1 = \sum_k^n L(k-2n)S(k) \quad (7)$$

$$cD_1 = \sum_k^n H(k-2n)S(k) \quad (8)$$

where, L and H are the decomposition filters of $S(n)$ in cA_1 and cD_1 , respectively. The base of the second decomposition level is cA_1 and the coefficients can be expressed as

$$cA_2 = \sum_k^n L(k-2n)cA_1(k) \quad (9)$$

$$cD_2 = \sum_k^n H(k-2n)cA_1(k) \quad (10)$$

Computation of the higher-level decompositions has a similar way. Hence, it can be seen that cA_1 is the approximate version of the original signal S . L behaves as a low-pass filter. If cD_1 contains only high frequency components of signal S , then H will behave as a high-pass filter. After the decomposition process, the original signal can be reconstructed again.

This recursive process can be expressed as

$$S' = A_n + D_n + D_{(n-1)} + \dots + D_2 + D_1 \quad (11)$$

and if the detail and approximation coefficients are not modified before the reconstruction process then S' will be equal to S . Fig. 1 shows frequency distribution up to 3 levels of decomposition [3].

In Fig. 2 the implementation procedure of a discrete wavelet transform is depicted. In this picture s is the original signal, $2\downarrow$ denotes a down sampling by a factor of 2, and LPF and HPF are the low-pass and high-pass frequency filters respectively. The original signal is divided into two halves of the frequency bandwidth at the first stage and sent to both LPF and HPF. The same procedure will be repeated and the output of the LPF will be further cut into half of the frequency bandwidth, and will form the input of the second level; this procedure is repeated until the signal is decomposed to the desired level. From Nyquist's theorem, if the sampling rate of the original signal is f_s Hz, the highest frequency that the original signal could contain, would be $f_s/2$ Hz. This frequency can be obtained at the output of the high frequency filter (first detail). Thus, the band of frequencies between $f_s/2$ and $f_s/4$ would be captured in detail 1; similarly, the band of frequencies between $f_s/4$ and

$f_s/8$ would be captured in detail 2, and so on [9].

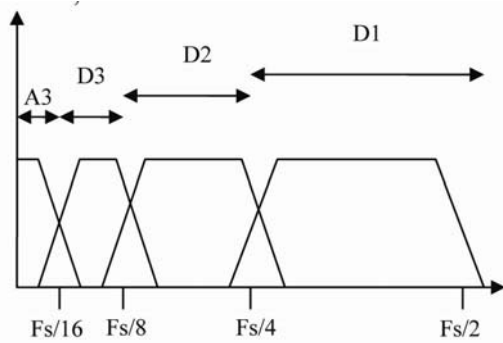


Fig.1 frequency distribution of 3 levels decomposition

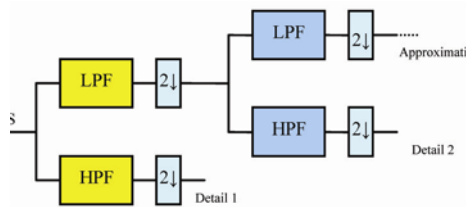


Fig. 2 implementation of discrete wavelet transforms

The sampling frequency in experimental test is adjusted to be 1000 Hz and Table I shows the frequency levels of the wavelet function coefficients. Daubechies-8 and Daubechies-12 wavelet are used in this paper as mother wavelet. The efficiency of Daubechies wavelets based on the accurate reconstruction of power system transient signals and the suitability of this family for the analysis of power system transients is the basis for choosing Daubechies-8 and Daubechies-12 [9]. As it can be seen from (2), frequency of goal harmonics for detection of broken rotor bar faults are $f_s[(1-s) \pm s]$, $f_s[5(1-s) \pm s]$, etc.

TABLE I. frequency levels of wavelet coefficients

Wavelet analysis	Frequency components Hz
D1	500 - 250
D2	250 - 125
D3	125 - 62.5
D4	62.5 - 31.2
A4	31.2 - 0

Supply frequency of the test set is 50 Hz so the frequency band of 30 Hz to 60 Hz is a good choice for detection of broken rotor bar fault. In this paper, relative RMS value of the

correspondent detail to the mentioned frequency band is used as a diagnosis parameter. Relative RMS value can be expressed as

$$\text{(detail RMS value)} / \text{(signal RMS value)} \quad (12)$$

Where RMS value of the discrete signal S can be determined by

$$s = \sqrt{\left(\frac{1}{n} \sum_{i=1}^n s_i^2 \right)} \quad (13)$$

4- EXPERIMENTAL RESULTS

Experiments on a three-phase 1.5-hp 380-V 50-Hz induction motor are carried out for normal and faulty conditions (two, three, four and five broken rotor bars). The rated speed of the induction motor is 1445 r/min. The induction motor is run around full-load condition, and the terminal voltages are sinusoidal. Fig. 3 shows the block diagram of the experimental setup used for the tests and Fig. 4 shows the photograph.

Relative RMS value of the correspondent detail to the mentioned frequency band is a good choice for the detection of broken rotor bars in induction motor. Tables 2 and 3 show the variation of the proposed parameter for healthy and faulty motor using different wavelets. The experimental results show the validity of the proposed approach to successfully classify healthy and faulty motors with high percentage of accuracy. Fig.5-8 illustrate the wavelet approximation and details diagrams of stator current signal in different conditions of motor.

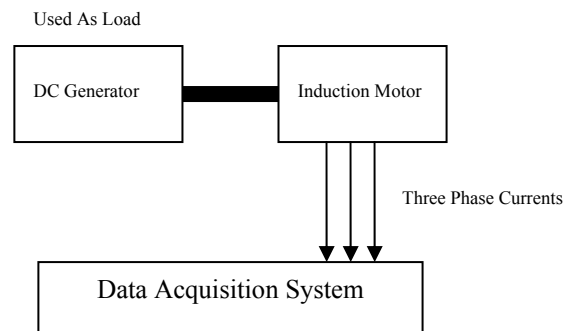


Fig 3. Block diagram of experimental setup



Fig.4 Experimental Test setup: Motor-Generator System (Right) and data acquisition system (left) [5]

Table.2 Variation of the proposed criteria in different conditions of motor using db-8 wavelet

Motor condition	Relative RMS value of the fourth detail
Healthy	0.04304
Two broken bars	0.49105
Three broken bars	0.13408
Four broken bars	0.22820
Five broken bars	0.25790

Table.3 Variation of the proposed criteria in different conditions of motor using db-12 wavelet

Motor condition	Relative RMS value of the fourth detail
Healthy	0.06371
Two broken bars	0.48837
Three broken bars	0.13077
Four broken bars	0.22843
Five broken bars	0.25878

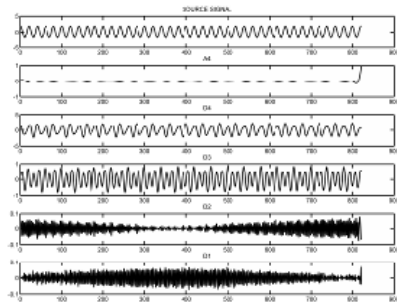


Fig.5 Wavelet decomposition of stator current using db-8 in healthy condition

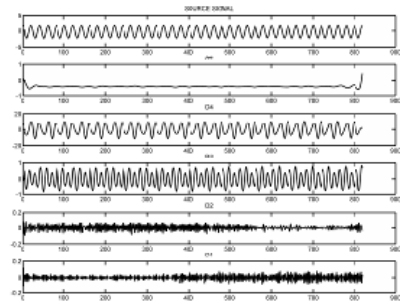


Fig.6 Wavelet decomposition of stator current using db-8 in faulty conditions (5 broken bars)

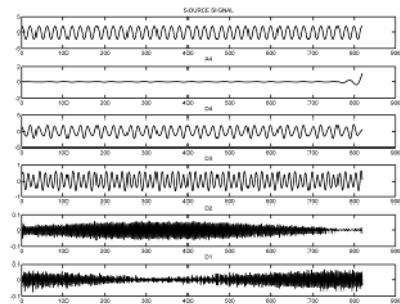


Fig.7 Wavelet decomposition of stator current using db-12 in healthy condition

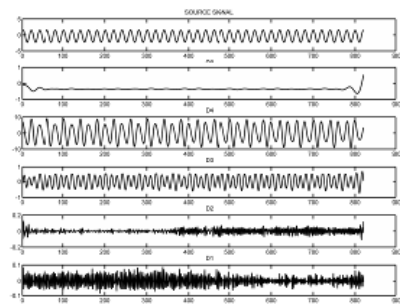


Fig.8 Wavelet decomposition of stator current using db-8 in faulty conditions (5 broken bars)

As it can be seen from tables 2 and 3, the proposed criteria successfully differentiates healthy and faulty rotor conditions. Since the proposed algorithm does not directly measure the amplitude of a special fault related frequency in stator current spectra, the proposed criteria is not directly proportional to the fault level.

5- conclusion

In this paper, a signal processing-based fault detection approach is developed and tested for the detection of induction-motor broken rotor bar faults. The method is based on wavelet

analysis of stator currents in combination with RMS computation of wavelet coefficients. The proposed method is in addition applied to experimental data obtained from previously test on a 1.5-hp induction motor and the results show that the proposed approach has the ability of detecting faulty conditions with high accuracy.

6- REFERENCES

- Z. Ye, B. Wu, and A. Sadeghian, "Current Signature Analysis of Induction Motor Mechanical Faults by Wavelet Packet Decomposition", IEEE TRANS. INDUSTRIAL ELECTRONICS, VOL. 50, NO. 6, DECEMBER 2003
- T. W. S. Chow and S. Hai, "Induction Machine Fault Diagnostic Analysis with Wavelet Technique", IEEE TRANS. INDUSTRIAL ELECTRONICS, VOL. 51, NO. 3, JUNE 200
- G. Didier, E. Temisien, O. Caspa, H. Razik, H. Henao, A. Yazidi, and G.-A. Capolino, "Rotor Fault Detection Using the Instantaneous Power Signature", IEEE INTERNATIONAL CONFERENCE ON INDUSTRIAL TECHNOLOGY, VOL. 1, pp. 170-174, Dec. 2004
- Z.Chen, J. Meng, B. Liang and D. Guo, "Fault Diagnosis of AC Squirrel-cage Asynchronous Motors based on Wavelet Packet-Neural Network", THE INTERNATIONAL CONFERENCE ON "COMPUTER AS A TOOL" EUROCON 2007
- K. Ahmadian, A. Jalilian, "A New Method in Modeling of Rotor Bar Skew Effect in Induction Motor Based on 2D-Modified Winding Function Method", PROCEEDING OF INTERNATIONAL POWER ENGINEERING CONFERENCE – IPEC2007
- H. Sadri, A. Jalilian, "Induction Motor Broken Rotor Bar Fault Detection Using Wavelet Analysis", MASTER'S THESIS, IRAN UNIVERSITY OF SCIENCE & TECHNOLOGY, Feb, 2004
- R. Supangat, N. Ertugrul, W.L. Soong, D.A. Gray, C. Hansen, and J. Grieger, "Broken Rotor Bar Fault Detection in Induction Motors Using Starting Current Analysis", 2005 EUROPEAN CONFERENCE ON POWER ELECTRONICS AND APPLICATIONS, Sep. 2005.
- W. T. Thomson, — "A-review of Online Condition Monitoring Techniques for Three-phase Squirrel Cage Induction Motors-Past Present and Future", IEEE SDEMPED'99, Spain, Sept. 1999, pp. 3-18
- J. Faiz , B.M. Ebrahimi , Asaie, R. Rajabioun and H. A. Toliyat, "A Criterion Function for Broken Bar Fault Diagnosis in Induction Motor under Load Variation using Wavelet Transform", PROCEEDING OF INTERNATIONAL CONFERENCE ON ELECTRICAL MACHINES AND SYSTEMS, 2007
- J. Cusidó, L. Romeral, J. A. Ortega, J.r A. Rosero, and A. García Espinosa, "Fault Detection in Induction Machines Using Power spectral Density in Wavelet Decomposition", IEEE TRANSACTIONS ON INDUSTRIAL ELECTRONICS, VOL. 55, NO. 2, Feb 2008